


## INSTALLATION INSTRUCTIONS

### Direct Replacement Procedure

1. Turn off the power to the fixture at the breaker panel before installation.
2. Open the diffuser from the light fixture.
3. Remove the fluorescent tube and dispose of it properly as it may contain mercury.
4. Make the new wire connection (A) to the branch circuit.
5. When installing the LED tube, ensure that the pins are firmly seated in lamp holders, and then close the diffuser.
6. Switch on the power to the fixture at the breaker panel.

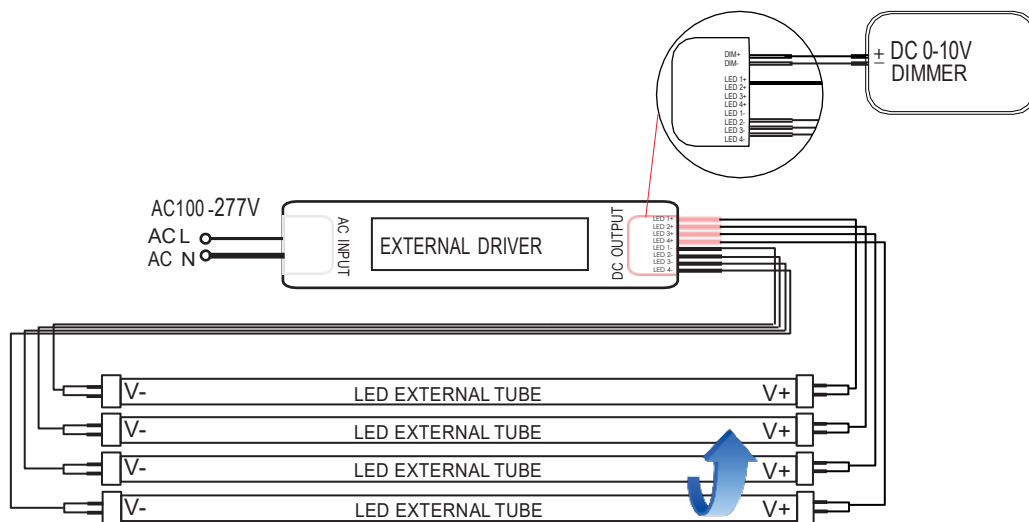

\*As shown in the image, one driver is enough for 4 tubes.

### Caution:

- Risk of fire. Do not install this light in a pre-heated fixture.
- Loose or damaged end caps and/or lamp holders need to be replaced before installation.
- To avoid the risk of an electric shock, do the installation while wearing gloves.
- Use to retrofit only those fluorescent lamps that are specified on the label.
- This tube is intended for use with emergency exits.
- This tube is be used with a light dimmer.
- If the lamp or luminaire exhibits undesirable operation (buzzing, flickering, etc.), immediately turn off power and remove the lamp from luminaire and contact manufacturer.
- Not suitable for wet locations.
- Do not make mass installation before sample testing.